



ZigBee Cluster Library

Illuminance Measurement Cluster

(0x0400)

Test Specification

Version 0.9

ZigBee Document 15-0316-06

October 11th, 2016

Sponsored by: ZigBee Alliance

Accepted by This document has not yet been accepted for release by the
ZigBee Alliance Board of Directors

Abstract This document describes the certification tests for devices
which implement the ZCL Illuminance Measurement
cluster.

Keywords ZCL, Illuminance Measurement, cluster

Copyright © ZigBee Alliance, Inc. (1996-2016). All rights reserved.

508 Second Street, Suite 206 Davis, CA 95616 - USA

<http://www.zigbee.org>

Permission is granted to members of the ZigBee Alliance to reproduce this document for their own use or the use of other ZigBee Alliance members only, provided this notice is included. All other rights reserved. Duplication for sale, or for commercial or for-profit use is strictly prohibited without the prior written consent of the ZigBee Alliance.

1

2

This page is intentionally blank

3 Notice of use and disclosure

4 Copyright © ZigBee Alliance, Inc. (1996-2016). All rights Reserved. This
5 information within this document is the property of the ZigBee Alliance and its use
6 and disclosure are restricted.

7 Elements of ZigBee Alliance specifications may be subject to third party intellectual
8 property rights, including without limitation, patent, copyright or trademark rights
9 (such a third party may or may not be a member of ZigBee). ZigBee is not responsible
10 and shall not be held responsible in any manner for identifying or failing to identify
11 any or all such third party intellectual property rights.

12 No right to use any ZigBee name, logo or trademark is conferred herein. Use of any
13 ZigBee name, logo or trademark requires membership in the ZigBee Alliance and
14 compliance with the ZigBee Logo and Trademark Policy and related ZigBee policies.

15 This document and the information contained herein are provided on an “AS IS” basis
16 and ZigBee DISCLAIMS ALL WARRANTIES EXPRESS OR IMPLIED,
17 INCLUDING BUT NOT LIMITED TO (A) ANY WARRANTY THAT THE USE
18 OF THE INFORMATION HEREIN WILL NOT INFRINGE ANY RIGHTS OF
19 THIRD PARTIES (INCLUDING WITHOUT LIMITATION ANY
20 INTELLECTUAL PROPERTY RIGHTS INCLUDING PATENT, COPYRIGHT OR
21 TRADEMARK RIGHTS) OR (B) ANY IMPLIED WARRANTIES OF
22 MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, TITLE OR
23 NONINFRINGEMENT. IN NO EVENT WILL ZIGBEE BE LIABLE FOR ANY
24 LOSS OF PROFITS, LOSS OF BUSINESS, LOSS OF USE OF DATA,
25 INTERRUPTION OF BUSINESS, OR FOR ANY OTHER DIRECT, INDIRECT,
26 SPECIAL OR EXEMPLARY, INCIDENTAL, PUNITIVE OR CONSEQUENTIAL
27 DAMAGES OF ANY KIND, IN CONTRACT OR IN TORT, IN CONNECTION
28 WITH THIS DOCUMENT OR THE INFORMATION CONTAINED HEREIN,
29 EVEN IF ADVISED OF THE POSSIBILITY OF SUCH LOSS OR DAMAGE. All
30 Company, brand and product names may be trademarks that are the sole property of
31 their respective owners.

32 The above notice and this paragraph must be included on all copies of this document
33 that are made.

34

35

36

37

This page is intentionally blank

38

Revision history

Revision	Date	Details	Editor
00	May, 2015	Created from Illuminance Measurement test specifications.	Phil Jamieson
01	August 12 th , 2015	Resolved comments received since the Hull test event in June 2015.	Phil Jamieson
02	September 30 th , 2015	Added the new mandatory global attributes.	Phil Jamieson
03	October 30 th , 2015	Addressed comments from the v0.9 ballot.	Phil Jamieson
04	September 29 th , 2016	Addressed comments from the ZigBee 3.0 SVE.	Phil Jamieson
05	October 7 th , 2016	Added global attribute 0xfffe to the PICS. Added a default reporting configuration test into IM-TC-03S.	Phil Jamieson
06	October 11 th , 2016	Clarified the reporting test case IM-TC-03S to remove the <= tests as this would allow a report at less than the minimal interval and to add further default reporting configuration tests.	Phil Jamieson

39

40

41

42

This page is intentionally blank

43

44

Table of Contents

45	1	Introduction.....	9
46	1.1	Conformance levels.....	9
47	2	References.....	10
48	2.1	ZigBee Alliance documents	10
49	2.2	IETF documents	10
50	3	PIXIT items.....	11
51	4	PICS	12
52	4.1	Usage	12
53	4.2	Server.....	12
54	4.2.1	Attributes.....	12
55	4.3	Client	13
56	4.3.1	Attributes.....	13
57	5	Test specification	14
58	5.1	Introduction	14
59	5.1.1	Test case overview	14
60	5.1.2	Testing tolerances	14
61	5.1.3	Client DUTs	14
62	5.1.4	Test steps manipulating attributes.....	14
63	5.2	Generic test cases	15
64	5.2.1	IM-TC-01G: Global attributes	15
65	5.3	Server test cases.....	19
66	5.3.1	IM-TC-01S: Attributes with server as DUT	19
67	5.3.2	IM-TC-02S: Primary functionality with server as DUT.....	24
68	5.3.3	IM-TC-03S: Reporting functionality with server as DUT.....	27
69	5.4	Client test cases	32
70	5.4.1	IM-TC-01C: Functionality with client as DUT	32
71	6	Annex A: PICS to test case cross reference.....	35
72	6.1	Server.....	35
73	6.2	Client	35

74

75

76

77

78

This page is intentionally blank

1 Introduction

This document contains the PICS, test specification and PICS/test case cross reference for the ZCL *illuminance measurement* cluster.

1.1 Conformance levels

The key words "SHALL", "SHALL NOT", "SHOULD", "SHOULD NOT", "RECOMMENDED" and "MAY" in this document are to be interpreted as described in [R4].

2 References

2.1 ZigBee Alliance documents

- [R1] ZigBee Cluster Library Specification, ZigBee Alliance document 07-5123.
- [R2] ZCL General Test Specification, ZigBee Alliance document 15-0xxx.
- [R3] ZCL Illuminance Measurement Cluster XML PICS, ZigBee Alliance document 15-0xxx.

2.2 IETF documents

- [R4] S. Bradner, Key words for use in RFCs to Indicate Requirement Levels, IETF RFC 2119, March 1997.

95

3 PIXIT items

Item number	Feature	Support
IM.PIXIT01	What is the reportable change to be used for generating a report for the <i>MeasuredValue</i> attribute?	<i>“Reportable change”</i>

96

4 PICS

All references are for the ZigBee Cluster Library specification [R1] unless otherwise indicated.
An XML version of these PICS is also available in [R3].

4.1 Usage

Item number	Feature	Reference	Status	Support
IM.S	Does the device implement the <i>illuminance measurement</i> cluster as a server?	4.2.2	O	Yes/No
IM.C	Does the device implement the <i>illuminance measurement</i> cluster as a client?	4.2.3	O	Yes/No

4.2 Server

4.2.1 Attributes

Item number	Feature	Reference	Status	Support
IM.S.A0000	Does the device implement the <i>MeasuredValue</i> attribute?	Table 4.6, 4.2.2.2.1.1	IM.S: M	Yes/No
IM.S.A0000.Report.Tx	Does the device implement receiving and responding to the global report attribute commands for the <i>MeasuredValue</i> attribute and sending reports?	4.2.2.5	IM.S.A0000: M	Yes/No
IM.S.A0001	Does the device implement the <i>MinMeasuredValue</i> attribute?	Table 4.6, 4.2.2.2.1.2	IM.S: M	Yes/No
IM.S.A0002	Does the device implement the <i>MaxMeasuredValue</i> attribute?	Table 4.6, 4.2.2.2.1.3	IM.S: M	Yes/No
IM.S.A0003	Does the device implement the <i>Tolerance</i> attribute?	Table 4.6, 4.2.2.2.1.4	IM.S: O	Yes/No
IM.S.A0004	Does the device implement the <i>LightSensorType</i> attribute?	Table 4.6, 4.2.2.2.1.5	IM.S: O	Yes/No
IM.S.Afffd	Does the device implement the <i>ClusterRevision</i> global attribute?	Table 2-1, 2.3.5.1.1	IM.S: M	Yes/No
IM.S.Afffe	Does the device implement the <i>AttributeReportingStatus</i> global attribute?	Table 2-1, 2.3.5.1.1	IM.S: O	Yes/No

4.3 Client

4.3.1 Attributes

Item number	Feature	Reference	Status	Support
IM.C.A0000.Report.Rsp	Does the device implement sending global report attribute command requests and receiving reports for the <i>MeasuredValue</i> attribute?	4.2.2.5	IM.C: O	Yes /No
IM.C.Afffd	Does the device implement the <i>ClusterRevision</i> global attribute?	Table 2-1, 2.3.5.1.1	IM.C: M	Yes /No
IM.C.Afffe	Does the device implement the <i>AttributeReportingStatus</i> global attribute?	Table 2-1, 2.3.5.1.1	IM.C: O	Yes/ No

5 Test specification

5.1 Introduction

5.1.1 Test case overview

The following test cases are available for the *illuminance measurement* cluster:

Test ID	Description	Reference
Global tests		
IM-TC-01G	Global attributes	5.2.1
Server side tests		
IM-TC-01S	Attributes with server as DUT	5.3.1
IM-TC-02S	Primary functionality with server as DUT	5.3.2
IM-TC-03S	Reporting functionality with server as DUT	5.3.3
Client side tests		
IM-TC-01C	Functionality with client as DUT	5.4.1

5.1.2 Testing tolerances

In test cases where a change in an attribute value is tested over time, it is permitted for the devices involved in the test to be within a tolerance of $\pm 15\%$ of the expected value. As such, these test cases indicate that the attribute value must be approximately equal to an expected value, to which the $\pm 15\%$ tolerance should then be applied. All other attribute values presented are expected to be exact.

5.1.3 Client DUTs

For client test cases only test steps that pertain to commands that are supported on the DUT are required to be executed. All commands in this cluster for which support is indicated in the PICS shall be exercised, using valid, application achievable values.

Note that for the client attribute test case, it is permissible for the client not to be able to execute any of the test steps.

The client SHALL ensure that an application link, e.g. a binding link, exists between itself and the test harness. This should be configured before starting the test.

5.1.4 Test steps manipulating attributes

In test case steps that require more than one attribute to be manipulated (e.g. read), the tester may decide whether it is appropriate or practical to send a single attribute manipulation command, containing multiple attributes, or multiple attribute manipulation commands, each containing a single attribute. The test case is designed to verify the behavior of the device supporting the attribute rather than verifying the attribute manipulation command in question.

5.2 Generic test cases

5.2.1 IM-TC-01G: Global attributes

This test case verifies the behavior of the global attributes of the *illuminance measurement* cluster client and server.

In this test, the PICS notation IM.S.Agm and IM.C.Agm represents the list of global attributes that are specified as being mandatory for either the server or client, respectively. Similarly, the PICS notation IM.S.Ago and IM.C.Ago represents the list of global attributes that are specified as being optional for either the server or client, respectively.

5.2.1.1 Scope

General:

- *Read attributes* command (0x00)
- *Read attributes response* command (0x01)
- *Write attributes* command (0x02)
- *Write attributes response* command (0x04)



Illuminance measurement cluster (0x0400):

- All global attributes

PICS:

- IM.S, IM.C
- IM.S.Agm, IM.C.Agm, IM.S.Ago, IM.C.Ago


5.2.1.2 Required devices

Designation	Symbol	Description
DUT		Device under test implementing: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster server or client.
TH		Test harness implementing: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster client or server, i.e. the opposite cluster instantiation as implemented on the DUT.

5.2.1.3 Initial conditions

Item	Initial Conditions
1	A packet sniffer shall be observing the communication over the air interface.
2	All devices are factory new and powered off until used.

5.2.1.4 Test preparation

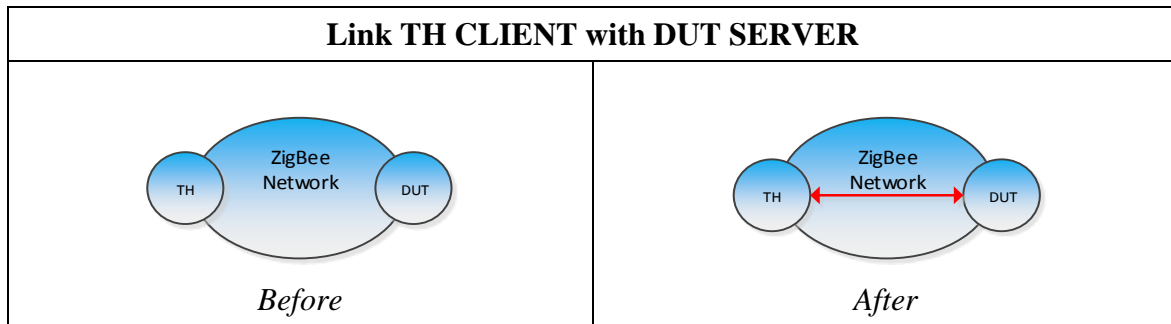

IM-TC-01G: Global attributes		
Item	Preparation Step	Observation
P1	Form a ZigBee network.	Observe appropriate command frame to form the network.
P2	Power on TH and DUT.	TH and DUT are powered on.
P3	Join TH and DUT to a ZigBee network.	Observe appropriate communication between TH, DUT and any other relevant node on the ZigBee network.

--- End of test case IM-TC-01G preparation ---

160 **5.2.1.5 Test procedure**

IM-TC-01G: Global attributes			
Item	PICS	Test Harness Step	DUT pass Verification
1	IM.S.Agm, IM.C.Agm	TH unicasts a ZCL <i>read attributes</i> command frame to DUT to read each mandatory global attribute of this cluster one at a time.	DUT unicasts a ZCL <i>read attributes response</i> command frame to TH containing each requested attribute. The data type in each command must match the value listed in the specification(s). The data value in each command for the attribute must fall within the valid range described in the specification(s).
2a	IM.S.Agm, IM.C.Agm	TH unicasts a ZCL <i>write attributes</i> command frame to DUT to write the respective default value to each mandatory global attribute of this cluster one at a time.	DUT unicasts a ZCL <i>write attributes response</i> command frame to TH for each attribute. If the access control of DUT is set to READ, the DUT response will indicate that the attribute write command was not a SUCCESS. If the access control of DUT is set to READ/WRITE, the DUT response will indicate that the write command was a SUCCESS.
2b	IM.S.Agm, IM.C.Agm	TH unicasts a ZCL <i>read attributes</i> command frame to DUT to read back each attribute written in step 2a.	DUT unicasts a ZCL <i>read attributes response</i> command frame to TH containing the requested attribute. If the <i>Status</i> field of the <i>write attributes response</i> command frame was equal to SUCCESS, the updated value is read back. If the <i>Status</i> field of the <i>write attributes response</i> command frame was not equal to SUCCESS the value is not updated when read back.

Continued...

IM-TC-01G: Global attributes			
Item	PICS	Test Harness Step	DUT pass Verification
3	IM.S.Ago, IM.C.Ago	TH unicasts a ZCL <i>read attributes</i> command frame to DUT to read each optional global attribute of this cluster one at a time.	DUT unicasts a ZCL <i>read attributes response</i> command frame to TH containing each attribute. If the DUT implements the attribute, the <i>Status</i> field will be equal to SUCCESS and the command will contain the requested attribute. If the DUT does not implement the attribute, the <i>Status</i> field will not be equal to SUCCESS. The data type in each command must match the value listed in the specification(s). The data value in each command for the attribute must fall within the valid range described in the specification(s).
4a	IM.S.Ago, IM.C.Ago	TH unicasts a ZCL <i>write attributes</i> command frame to DUT to write the respective default value to each optional global attribute of this cluster one at a time.	DUT unicasts a ZCL <i>write attributes response</i> command frame to TH for each attribute. If the attribute is not implemented or the access control of DUT is set to READ, the DUT response will indicate that the attribute write command was not a SUCCESS. If the attribute is implemented and the access control of DUT is set to READ/WRITE, the DUT response will indicate that the write command was a SUCCESS.
4b	IM.S.Ago, IM.C.Ago	TH unicasts a ZCL <i>read attributes</i> command frame to DUT to read back each attribute written in step 4a.	DUT unicasts a ZCL <i>read attributes response</i> command frame to TH containing the requested attribute. If the <i>Status</i> field of the <i>write attributes response</i> command frame was equal to SUCCESS, the updated value is read back. If the <i>Status</i> field of the <i>write attributes response</i> command frame was not equal to SUCCESS the value is not updated when read back.

--- End of test case IM-TC-01G ---

5.3 Server test cases

5.3.1 IM-TC-01S: Attributes with server as DUT

This test case verifies the behavior of the attributes of the *illuminance measurement* cluster server.

In this test, the PICS notation IM.S.Am represents the list of non-global attributes that are specified as being mandatory. Similarly, the PICS notation IM.S.Ao represents the list of non-global attributes that are specified as being optional.

5.3.1.1 Scope

General:

- *Read attributes* command (0x00)
- *Read attributes response* command (0x01)
- *Write attributes* command (0x02)
- *Write attributes response* command (0x04)



Illuminance measurement cluster (0x0400):

- All non-global attributes

PICS:

- IM.S,
- IM.S.Am, IM.S.Ao


5.3.1.2 Required devices

Designation	Symbol	Description
TH CLIENT		Test harness client implementing: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster client.
DUT SERVER		Device under test server: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster server.

5.3.1.3 Initial conditions

Item	Initial Conditions
1	A packet sniffer shall be observing the communication over the air interface.
2	All devices are factory new and powered off until used.

5.3.1.4 Test preparation

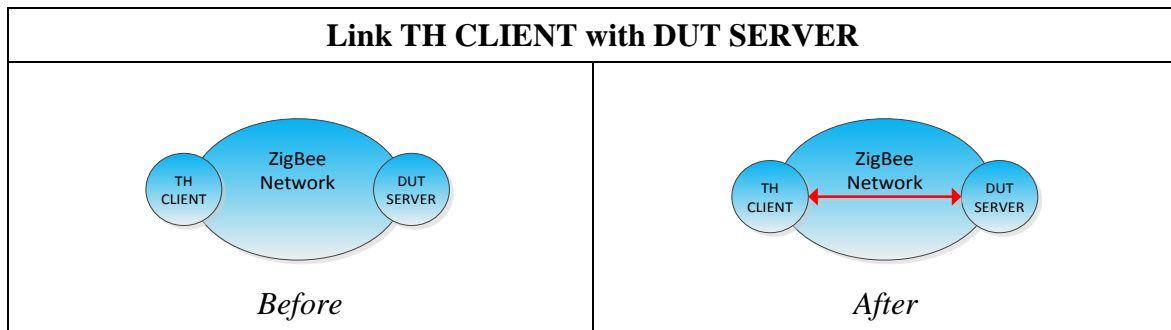

IM-TC-01S: Attributes with server as DUT		
Item	Preparation Step	Observation
P1	Form a ZigBee network.	Observe appropriate command frame to form the network.
P2	Power on TH CLIENT and DUT SERVER.	TH CLIENT and DUT SERVER are powered on.
P3	Join TH CLIENT and DUT SERVER to a ZigBee network.	Observe appropriate communication between TH CLIENT, DUT SERVER and any other relevant node on the ZigBee network.

--- End of test case IM-TC-01C preparation ---

187 **5.3.1.5 Test procedure**

IM-TC-01S: Attributes with server as DUT			
Item	PICS	Test Harness Step	DUT pass Verification
1	IM.S.Am	TH CLIENT unicasts a ZCL <i>read attributes</i> command frame to DUT SERVER to read each mandatory attribute of this cluster one at a time.	DUT SERVER unicasts a ZCL <i>read attributes response</i> command frame to TH CLIENT containing each requested attribute. The data type in each command must match the value listed in the specification(s). The data value in each command for the attribute must fall within the valid range described in the specification(s).
2a	IM.S.Am	TH CLIENT unicasts a ZCL <i>write attributes</i> command frame to DUT SERVER to write the respective default value to each mandatory attribute of this cluster one at a time.	DUT SERVER unicasts a ZCL <i>write attributes response</i> command frame to TH CLIENT for each attribute. If the access control of DUT SERVER is set to READ, the DUT SERVER response will indicate that the attribute write command was not a SUCCESS. If the access control of DUT SERVER is set to READ/WRITE, the DUT SERVER response will indicate that the write command was a SUCCESS.
2b	IM.S.Am	TH CLIENT unicasts a ZCL <i>read attributes</i> command frame to DUT SERVER to read back each attribute written in step 2a.	DUT SERVER unicasts a ZCL <i>read attributes response</i> command frame to TH CLIENT containing the requested attribute. If the <i>Status</i> field of the <i>write attributes response</i> command frame was equal to SUCCESS, the updated value is read back. If the <i>Status</i> field of the <i>write attributes response</i> command frame was not equal to SUCCESS the value is not updated when read back.

Continued...

IM-TC-01S: Attributes with server as DUT			
Item	PICS	Test Harness Step	DUT pass Verification
3	IM.S.Ao	TH CLIENT unicasts a ZCL <i>read attributes</i> command frame to DUT SERVER to read each optional attribute of this cluster one at a time.	<p>DUT SERVER unicasts a ZCL <i>read attributes response</i> command frame to TH CLIENT containing each attribute.</p> <p>If the DUT SERVER implements the attribute, the <i>Status</i> field will be equal to SUCCESS and the command will contain the requested attribute. If the DUT SERVER does not implement the attribute, the <i>Status</i> field will not be equal to SUCCESS.</p> <p>The data type in each command must match the value listed in the specification(s). The data value in each command for the attribute must fall within the valid range described in the specification(s).</p>
4a	IM.S.Ao	TH CLIENT unicasts a ZCL <i>write attributes</i> command frame to DUT SERVER to write the respective default value to each optional attribute of this cluster one at a time.	<p>DUT SERVER unicasts a ZCL <i>write attributes response</i> command frame to TH CLIENT for each attribute.</p> <p>If the attribute is not implemented or the access control of DUT SERVER is set to READ, the DUT SERVER response will indicate that the attribute write command was not a SUCCESS. If the attribute is implemented and the access control of DUT SERVER is set to READ/WRITE, the DUT response will indicate that the write command was a SUCCESS.</p>

Continued...

IM-TC-01S: Attributes with server as DUT			
Item	PICS	Test Harness Step	DUT pass Verification
4b	IM.S.Ao	TH CLIENT unicasts a ZCL <i>read attributes</i> command frame to DUT SERVER to read back each attribute written in step 4a.	DUT SERVER unicasts a ZCL <i>read attributes response</i> command frame to TH CLIENT containing the requested attribute. If the <i>Status</i> field of the <i>write attributes response</i> command frame was equal to SUCCESS, the updated value is read back. If the <i>Status</i> field of the <i>write attributes response</i> command frame was not equal to SUCCESS the value is not updated when read back.

--- End of test case IM-TC-01S ---

188

189

5.3.2 IM-TC-02S: Primary functionality with server as DUT

This test case verifies the primary functionality of the *illuminance measurement* cluster server.

5.3.2.1 Scope

General:

- *Read attributes* command (0x00)
- *Read attributes response* command (0x01)
- *Write attributes* command (0x02)
- *Write attributes response* command (0x04)



Illuminance measurement cluster (0x0400):

- *MeasuredValue* attribute (0x0000)
- *MinMeasuredValue* attribute (0x0001)
- *MaxMeasuredValue* attribute (0x0002)

PICS:

- IM.S
- IM.S.A0000 – IM.S.A0002


5.3.2.2 Required devices

Designation	Symbol	Description
TH CLIENT		Test harness client implementing: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster client.
DUT SERVER		Device under test server implementing: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster server.
-	-	A dimmable light source to adjust the illuminance.

5.3.2.3 Initial conditions

Item	Initial Conditions
1	A packet sniffer shall be observing the communication over the air interface.
2	All devices are factory new and powered off until used.
3	The light source is set to some value of the tester's choice.

5.3.2.4 Test preparation

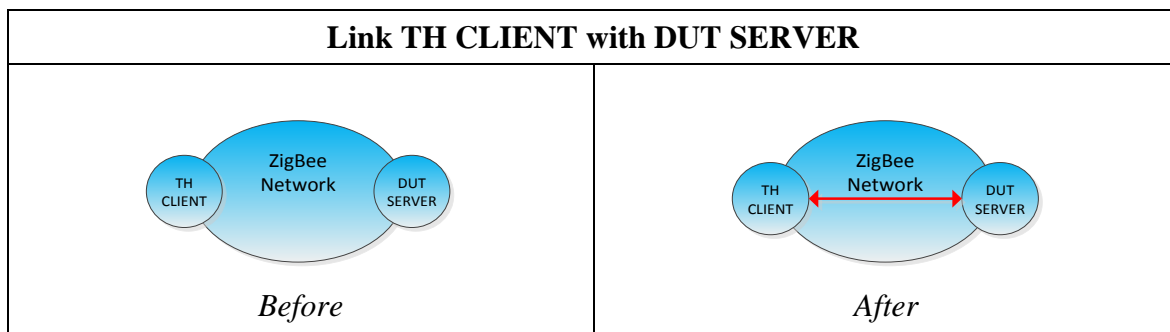

IM-TC-02S: Primary functionality with server as DUT		
Item	Preparation Step	Observation
P1	Form a ZigBee network.	Observe appropriate command frame to form the network.
P2	Power on TH CLIENT and DUT SERVER.	TH CLIENT and DUT SERVER are powered on.
P3	Join TH CLIENT and DUT SERVER to a ZigBee network.	Observe appropriate communication between TH CLIENT, DUT SERVER and any other relevant node on the ZigBee network.

--- End of test case IM-TC-02S preparation ---

216 **5.3.2.5 Test procedure**

IM-TC-02S: Primary functionality with server as DUT			
Item	PICS	Test Harness Step	DUT Pass Verification
1a	IM.S.A0001, IM.S.A0002	TH CLIENT unicasts a ZCL <i>read attributes</i> command frame to DUT SERVER to read the <i>MinMeasuredValue</i> and <i>MaxMeasuredValue</i> attributes.	DUT SERVER unicasts a ZCL <i>read attributes response</i> command frame to TH CLIENT. <i>MinMeasuredValue</i> and <i>MaxMeasuredValue</i> attributes have values specific to DUT SERVER.
1b	-	Note the values of the <i>MinMeasuredValue</i> (I_{min}) and <i>MaxMeasuredValue</i> (I_{max}) attributes.	None
2	IM.S.A0000	TH CLIENT unicasts a ZCL <i>read attributes</i> command frame to DUT SERVER to read the <i>MeasuredValue</i> attribute.	DUT SERVER unicasts a ZCL <i>read attributes response</i> command frame to TH CLIENT. <i>MeasuredValue</i> attribute has the value 0x0000 (too low to be measured) or is in the range: $I_{min} \leq \text{MeasuredValue} \leq I_{max}$.
3a	-	Adjust the brightness of the light source such that it is visibly different.	None
3b	IM.S.A0000	TH CLIENT unicasts a ZCL <i>read attributes</i> command frame to DUT SERVER to read the <i>MeasuredValue</i> attribute.	DUT SERVER unicasts a ZCL <i>read attributes response</i> command frame to TH CLIENT. <i>MeasuredValue</i> attribute has a value in the range: $I_{min} \leq \text{MeasuredValue} \leq I_{max}$ and is different to the value measured in step 2.

--- End of test case IM-TC-02S ---

217
218

5.3.3 IM-TC-03S: Reporting functionality with server as DUT

This case test verifies the attribute reporting behavior of the *illuminance measurement* cluster server.

5.3.3.1 Scope

General:

- *Read attributes* command (0x00)
- *Read attributes response* command (0x01)
- *Configure reporting* command (0x06)
- *Configure reporting response* command (0x07)
- *Report attributes* command (0x0a)



Illuminance measurement cluster (0x0400):

- *MeasuredValue* attribute (0x0000)

PICS:

- IM.S
- IM.S.A0000
- IM.S.A0000.Report.Tx


5.3.3.2 Required devices

Designation	Symbol	Description
TH CLIENT		Test harness client implementing: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster client.
DUT SERVER		Device under test server implementing: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster server.
-	-	A dimmable light source to adjust the illuminance.

5.3.3.3 Initial conditions

Item	Initial Conditions
1	A packet sniffer shall be observing the communication over the air interface.
2	All devices are factory new and powered off until used.
3	The light source is set to some value of the tester's choice.

5.3.3.4 Test preparation

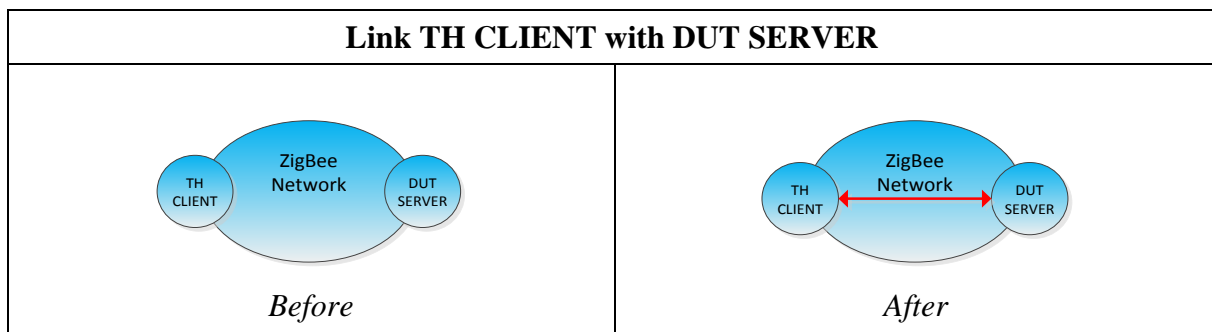

IM-TC-03S: Reporting functionality with server as DUT		
Item	Preparation Step	Observation
P1	Form a ZigBee network.	Observe appropriate command frame to form the network.
P2	Power on TH CLIENT and DUT SERVER.	TH CLIENT and DUT SERVER are powered on.
P3	Join TH CLIENT and DUT SERVER to a ZigBee network.	Observe appropriate communication between TH CLIENT, DUT SERVER and any other relevant node on the ZigBee network.
P5	Establish a binding link in the reverse direction from an endpoint on DUT SERVER to a corresponding endpoint on TH CLIENT that both support the <i>illuminance measurement</i> cluster.	Observe appropriate communication between DUT SERVER, TH CLIENT and any other relevant node on the ZigBee network.

--- End of test case IM-TC-03S preparation ---

245 **5.3.3.5 Test procedure**

IM-TC-03S: Reporting functionality with server as DUT			
Item	PICS	Test Harness Step	DUT Pass Verification
1a	IM.S.A0000	TH CLIENT unicasts a ZCL <i>read reporting configuration</i> command frame to DUT SERVER to read the default reporting configuration of the <i>MeasuredValue</i> attribute.	DUT SERVER unicasts a ZCL <i>read reporting configuration response</i> command frame to TH CLIENT with a single attribute reporting configuration record for the <i>MeasuredValue</i> attribute and the <i>status</i> field set to SUCCESS. Set RI_{max} to the value of the <i>maximum reporting interval</i> field. Store the default report parameters contained in the <i>read reporting configuration response</i> command frame.
1b	IM.S.A0000, IM.S.A0000.Report.Tx	Wait for the attribute report according to the default configuration.	At a time $\leq (RI_{max} + 2)$ seconds, DUT SERVER unicasts a ZCL <i>report attributes</i> command frame to TH CLIENT with the <i>MeasuredValue</i> attribute.
2a	IM.S.A0000, IM.S.A0000.Report.Tx	TH CLIENT unicasts a ZCL <i>configure reporting</i> command frame to DUT SERVER for the <i>MeasuredValue</i> attribute with a <i>direction</i> field set to 0x00, the <i>minimum reporting interval</i> field set to 0x001e (30 seconds), the <i>maximum reporting interval</i> field set to 0x003c (60 seconds) and the <i>reportable change</i> field set equal to IM.PIXIT01.	DUT SERVER unicasts a ZCL <i>configure reporting response</i> command frame to TH CLIENT, confirming the configured attributes and with the <i>status</i> field set to SUCCESS.

Continued...

IM-TC-03S: Reporting functionality with server as DUT			
Item	PICS	Test Harness Step	DUT Pass Verification
2b	IM.S.A0000, IM.S.A0000.Report. Tx	None	At a time approximately 60s after receiving the <i>configure reporting response</i> command frame in step 2a, DUT SERVER unicasts a ZCL <i>report attributes</i> command frame to TH CLIENT with the <i>MeasuredValue</i> attribute.
3a	-	Adjust the illuminance being measured such that it has changed by more than IM.PIXIT01 from its last value.	DUT SERVER does nothing.
3b	IM.S.A0000, IM.S.A0000.Report. Tx	None.	At a time approximately 30s after sending the report in step 2b, DUT SERVER unicasts a ZCL <i>report attributes</i> command frame to TH CLIENT with the <i>MeasuredValue</i> attribute.
3c	IM.S.A0000, IM.S.A0000.Report. Tx	None.	At a time approximately 60s after sending the report in step 3b, DUT SERVER unicasts a ZCL <i>report attributes</i> command frame to TH CLIENT with the <i>MeasuredValue</i> attribute.
4a	IM.S.A0000, IM.S.A0000.Report. Tx	TH CLIENT unicasts a ZCL <i>configure reporting</i> command frame to DUT SERVER for the <i>MeasuredValue</i> attribute and the <i>maximum reporting interval</i> field set to 0xffff (do not send reports).	DUT SERVER unicasts a ZCL <i>configure reporting response</i> command frame to TH CLIENT, confirming the configured attributes and with the <i>status</i> field set to SUCCESS.
4b	IM.S.A0000.Report. Tx	Wait for 62s after the report sent in step 2b.	DUT SERVER does not send any further reports.

Continued...

IM-TC-03S: Reporting functionality with server as DUT			
Item	PICS	Test Harness Step	DUT Pass Verification
5	IM.S.A0000	TH CLIENT unicasts a ZCL <i>read reporting configuration</i> command frame to DUT SERVER to read the default reporting configuration of the <i>MeasuredValue</i> attribute.	DUT SERVER unicasts a ZCL <i>read reporting configuration response</i> command frame to TH CLIENT with a single attribute reporting configuration record for the <i>MeasuredValue</i> attribute and the <i>status</i> field set to 0x8b (NOT_FOUND).
6a	IM.S.A0000	TH CLIENT unicasts a ZCL <i>configure reporting</i> command frame to DUT SERVER for the <i>MeasuredValue</i> attribute with a <i>direction</i> field set to 0x00, the <i>minimum reporting interval</i> field set to 0xffff and the <i>maximum reporting interval</i> field set to 0x0000 (restore default report configuration).	DUT SERVER unicasts a ZCL <i>configure reporting response</i> command frame to TH CLIENT, confirming the configured attributes and with the <i>status</i> field set to SUCCESS.
6b	IM.S.A0000	TH CLIENT unicasts a ZCL <i>read reporting configuration</i> command frame to DUT SERVER to read the default reporting configuration of the <i>MeasuredValue</i> attribute.	DUT SERVER unicasts a ZCL <i>read reporting configuration response</i> command frame to TH CLIENT with a single attribute reporting configuration record for the <i>MeasuredValue</i> attribute and the <i>status</i> field set to SUCCESS. Verify that the default reporting configuration is commensurate with the parameters stored in step 1a.
6c	IM.S.A0000, IM.S.A0000.Report.Tx	Wait for the attribute report according to the default configuration.	At a time $\leq (RI_{max} + 2)$ seconds, DUT SERVER unicasts a ZCL <i>report attributes</i> command frame to TH CLIENT with the <i>MeasuredValue</i> attribute.

--- End of test case IM-TC-03S ---

246

247

5.4 Client test cases

5.4.1 IM-TC-01C: Functionality with client as DUT

This case test verifies the functionality of the *illumination measurement* cluster client.

The DUT client SHALL be on the same network as a suitable server, provided by the user, and this device SHALL be used by the client to exercise its functionality. The test case uses the test harness to prompt the user, based on the declared PICS, to exercise the functionality of the *basic* cluster client and to verify the results. A sniffer tool SHALL be used to log the exercised functionality and to determine its validity.

In this test case, the PICS notation IM.C.CdTx represents the list of commands that are declared as being transmitted by the DUT.

5.4.1.1 Scope



General:

- *Configure reporting* command (0x06)

PICS:

- IM.C
- IM.C.A0000.Report.Rsp


5.4.1.2 Required devices

Designation	Symbol	Description
DUT CLIENT		Device under test client implementing: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster client.
SERVER		Suitable server device implementing: <ul style="list-style-type: none"> • The <i>illuminance measurement</i> cluster server.

5.4.1.3 Initial conditions

Item	Initial Conditions
1	A packet sniffer shall be observing the communication over the air interface.
2	All devices are factory new and powered off until used.

5.4.1.4 Test preparation

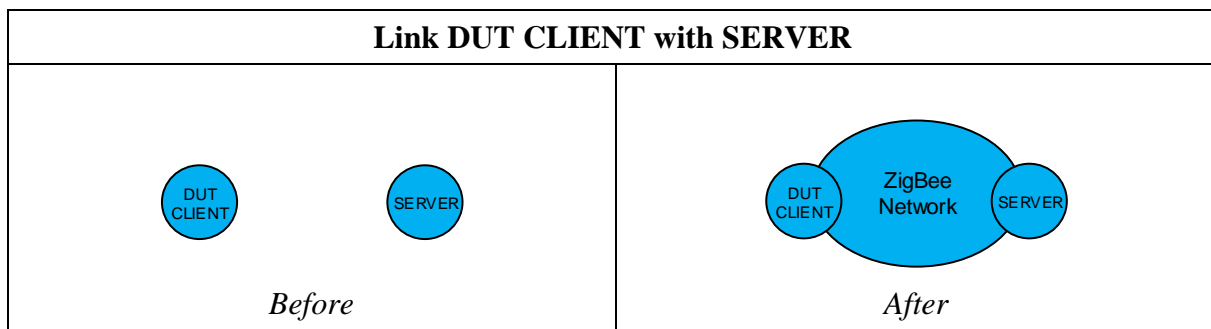

IM-TC-01C: Functionality with client as DUT		
Item	Preparation Step	Observation
P1	Power on the DUT CLIENT device and the SERVER device.	DUT CLIENT and SERVER are powered on.
P2	Ensure the DUT CLIENT device and the SERVER device are on the same ZigBee network.	Observe appropriate communication between DUT CLIENT, SERVER and any other relevant node on the ZigBee network.

--- End of test case IM-TC-01C preparation ---

5.4.1.5 Test procedure

IM-TC-01C: Functionality with client as DUT			
Item	PICS	Test Harness Step	DUT Pass Verification
1	-	Test harness prompts the user with a list of commands, based on the declared PICS, which the DUT CLIENT indicates it can transmit.	None.
2	IM.C.Cd.Tx	None.	DUT CLIENT transmits correctly formed commands in any order and with application achievable values. This is verified using the sniffer log.
3	-	Prompt the user to verify that the cluster commands listed in step 1 were transmitted during step 2.	During step 2, DUT CLIENT has transmitted every command listed by the test harness in step 1.
4	-	Prompt the user to verify that the cluster commands not listed in step 1 were not transmitted during step 2.	During step 2, DUT CLIENT has not transmitted any commands from this cluster that were not listed by the test harness in step 1.

--- End of test case IM-TC-01C ---

6 Annex A: PICS to test case cross reference

6.1 Server

PICS	Test case			
	IM-TC-01G	IM-TC-01S	IM-TC-02S	IM-TC-03S
IM.S	X	X	X	X
IM.S.A0000		X	X	X
IM.S.A0000.Report.Tx				X
IM.S.A0001		X	X	
IM.S.A0002		X	X	
IM.S.A0003		X		
IM.S.A0004		X		
IM.S.Afffd	X			
IM.S.Afffe	X			

6.2 Client

PICS	Test case	
	IM-TC-01G	IM-TC-01C
IM.C	X	X
IM.C.A0000.Report.Rsp		X
IM.C.Afffd	X	
IM.C.Afffe	X	